




**BP** • • • •

Battery chargers

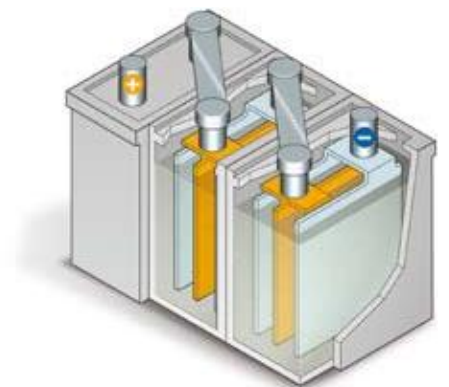

Technical addendum



## Content

1	Common features.....	6
1.1	Mounting .....	6
1.2	Definitions .....	7
1.3	Safety issues.....	7
1.4	Charge curve.....	8
1.5	Derating.....	9
1.6	Paralleling chargers .....	10
2	BPR (COMPACT) range.....	11
2.1	Protections.....	11
2.2	Connections .....	12
2.3	Comparison of the various models.....	13
3	BP range.....	14
3.1	Protections.....	14
3.2	Connections .....	15
3.3	Power factor .....	15
3.4	Comparison of the various models.....	16
4	BP+ range.....	17
4.1	Protections.....	17
4.2	Connections .....	18
4.3	Comparison of the various models.....	18
5	BPR B range.....	19
5.1	Overview.....	19
5.2	Protections.....	20
5.3	BPR B connections.....	21
5.4	Operation.....	21
5.5	Comparison of the various models.....	22



## DOCUMENT CONTROL

Version	Date	Details
A	Dec. 23 <sup>rd</sup> , 2014	First publication
B	April 27 <sup>th</sup> , 2015	Adding of BP+ range. More on IEC61010-1. Corrections on FAULT relays (text, photos and diagrams). Corrections on derating temperature of BP0524M & BP1012M.

This document is intended to help understand our Product information and technical documentations, and make informed choices. It starts with installation hints.

## 1 COMMON FEATURES


### 1.1 Mounting

Only install the charger in a pollution degree 2 environment (dry, well-ventilated locations).


Hang the charger vertically with the input terminal strip at the bottom.

To fasten the charger on the  $\Omega 35$  DIN rail (7.5 or 15):

1. Tilt the charger slightly rearwards
2. Fit the charger over top hat rail
3. Slide it downward until it hits the stop
4. Press against the bottom for locking
5. Shake the charger slightly to check the locking action

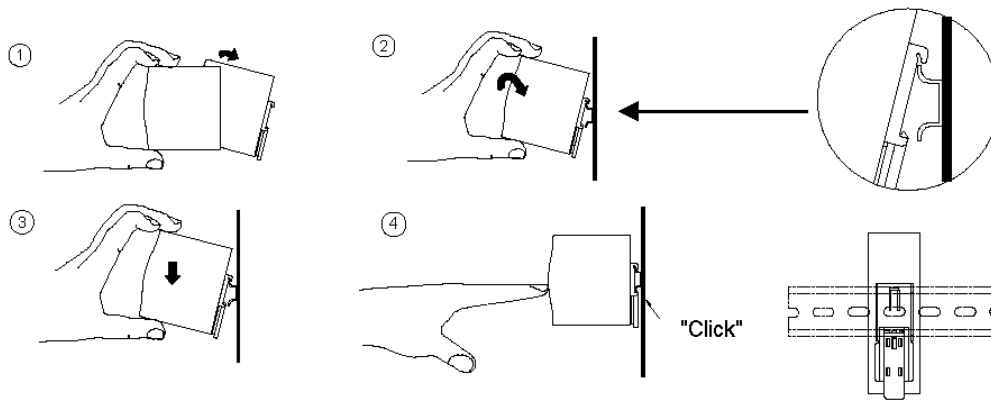


Clearances are recommended around a charger, when it is permanently at full power, especially if it is adjacent to a heat source:

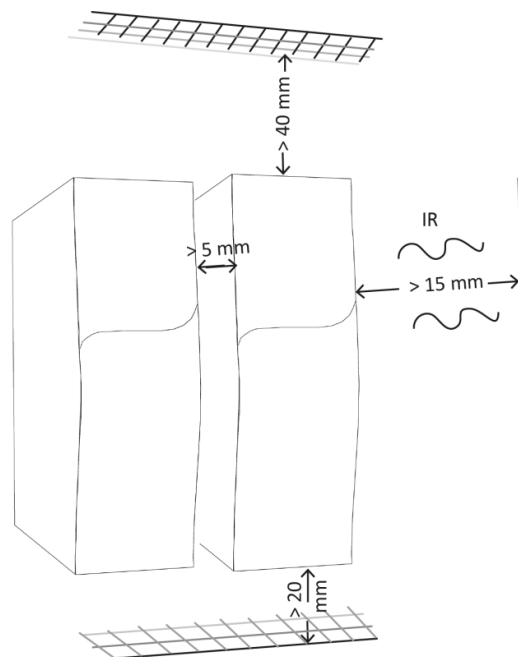


Derogation: DIN modules with diode or fuse. See further.

By design our chargers are category II regarding the installation. As illustrated for home and factory, the risk of electrical shock is higher upstream in the distribution system, especially if the location is lightning-prone:

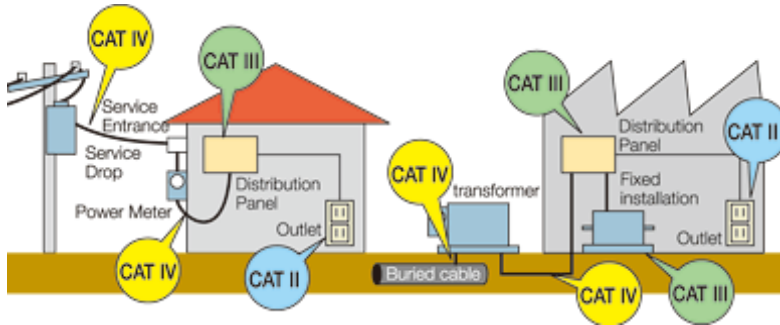

Categories according to IEC61010-1

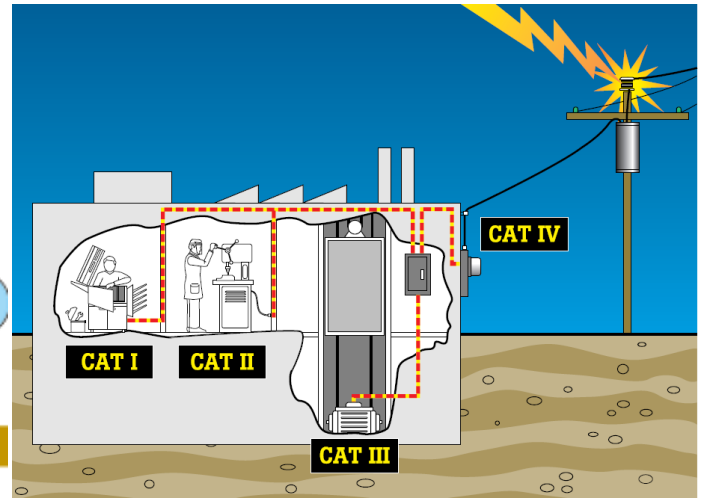

CAT II: all outlets at more than 10m from CAT III or 20m from CAT IV

If the category III or IV is required, a surge protection device must be added. Ask our customer service for advice.

**1.2 Definitions**

The individual technical documentations specify various characteristics, such as



- Charger inrush current: at power-on, a large pulse current is draft from the AC source for half to 1 cycle (1/100 ...1/50 ms in 50Hz). As a result, avoid recycling the power several times in a row. Besides, if several chargers are turned on at once, the high current may trip a protection; we recommend phasing in the starts
- Setup time: lead time after source connection
- Rise time: time for the output voltage to get steady
- Hold-up time: time when the nominal output voltage is still present after source loss
- Temperature coefficient: used to compensate the influence of temperature
- Leakage current: see the captions of the diagram blocks further (BP, BP+ and BPR B ranges)
- Charger efficiency: ratio of total power delivered by the charger to input power; it differs from 1 because of dissipation inside the charger
- Battery capacity: total charge the battery can store. The battery can deliver an energy (Wh) = average voltage x total charge (Ah). Rule of thumb: select a charger whose output current equals total charge/10 (C-rate = 0.1xC corresponding to slow charger)
- Charger float voltage: charge voltage at full charge

**1.3 Safety issues**

<b>⚠ DANGER</b>	
	<p><b>HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH</b></p> <ul style="list-style-type: none"> <li>▪ The unit must only be installed and serviced by qualified electrical personnel</li> <li>▪ Apply appropriate personal protective equipment (PPE), follow safe electrical work practices</li> <li>▪ Turn off power before installing or removing fuses, and before installing the unit</li> <li>▪ Use a properly rated voltage sensing device to confirm the power is off</li> <li>▪ Do not use renewable link fuses in fused switch</li> </ul>
	<p><b>Failure to follow these instructions will result in death or serious injury</b></p>

Connect the protective earth to ground. Isolate the charger from the AC source, before connecting or disconnecting a battery. Do not open the charger.


Never charge a frozen battery. Due to a charge imbalance risk, avoid charging batteries in parallel.

<b>⚠ WARNING</b>	
<b>HAZARD OF BURN &amp; FIRE</b>	
	Do not touch the unit in operation and shortly after disconnection
	Risk of fire and short circuit. Protect the openings from foreign objects or dripping liquids
<b>Failure to follow these instructions may result in serious injury</b>	

**1.4 Charge curve**

The charge takes place as follows:

- I constant, U increases to reach the nominal power
- I decreases
- I decreases rapidly to 0

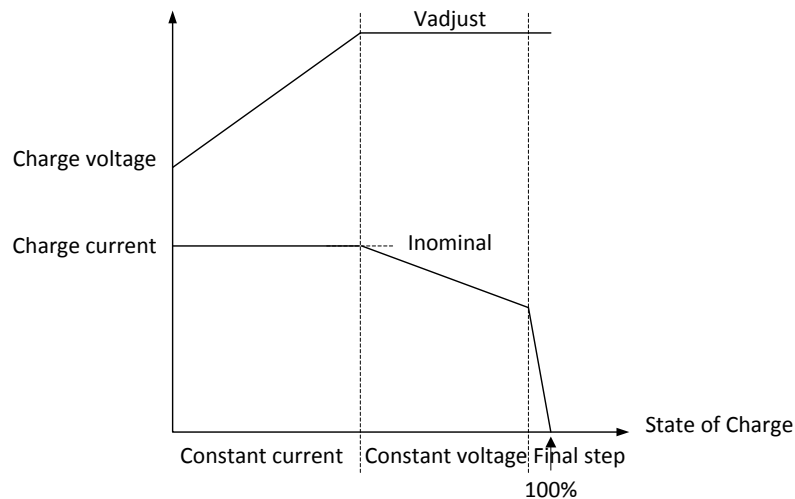

Note: in the flat sections, the curve may feature a slight slope due to temperature drifts.

For several types of battery and two nominal voltages, the following table shows the recommended Float and Boost voltages (Vboost is 4 ... 5% above Vfloat). You can take either voltage for Vadjust, but Vfloat is preferred if the battery remains connected after full charge is reached.

Battery rated voltage	NiCd		Gel /Lead-acid	
	Vfloat	Vboost	Vfloat	Vboost
12V	13.2V	13.8V	13.7V	14.2V
24V	26.4V	27.6V	27.4V	28.4V

This table is given for information only; check with the battery manufacturer.

To function as a "float charger" which senses the reduction in charging current and reduces the charging voltage, implement a boost strategy with a BPR B charger (see *BPRB range/Overview*); an external logic must remove the boost on time.

When the battery is used in a standby operation, such as the start of a diesel generator, the charge time does not matter a lot. It depends on the C-rate. During normal operation, the battery is at full capacity and the battery charger is used to maintain the float voltage of the battery.

The battery is only drained when the generator starts. As the generator has a DC charging alternator fitted, the battery is quickly recharged when the generator is running. If the generator stops before the battery is fully recharged, the charger continues to recharge the battery until it is fully charged.




### 1.5 Derating


The performance might downgrade beyond the specified limits in the technical documentations:

- AC voltage below lower limit:

Example: BP0524M (the AC voltage limit is 85V or 170V depending on the position of a switch)

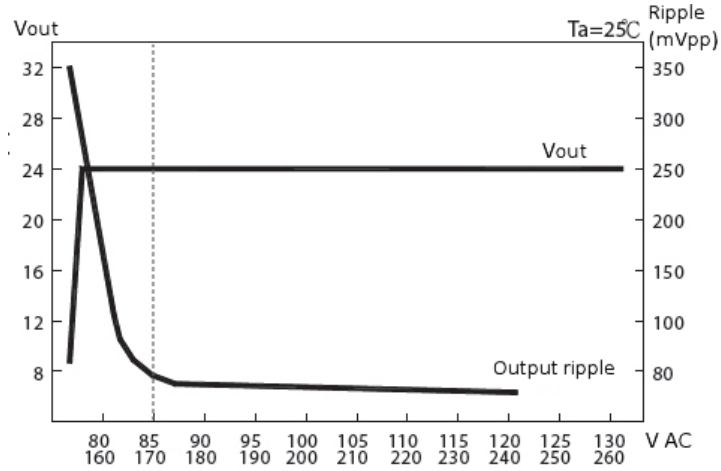

- Temperatures above the limits:

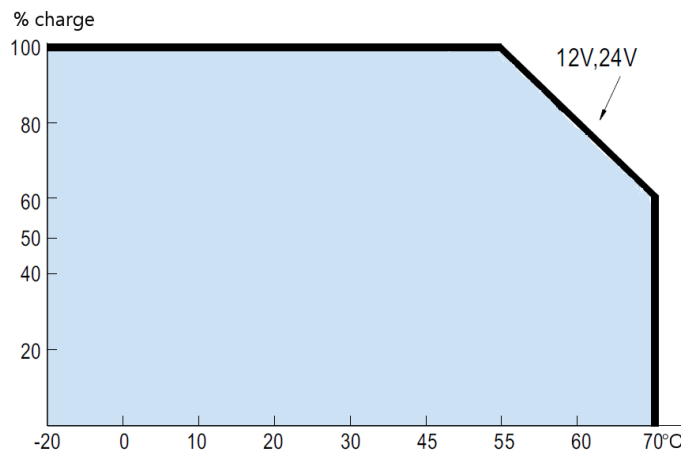


NOTE General outlines are shown here. To see the accurate curves, refer to the specific *Product information*.

## 1.6 Paralleling chargers

For a better availability or to increase the output currents, it is advised to parallelize several chargers.

Except for BP+ range (where the diode is built in), Schottky diodes must be installed so that there is no reverse current and harmonics do not add. Redundancy is also possible.

The diode SBX 2550 is connected between the terminals of a DIN terminal module. The kit includes the module and the diode. The chargers are hooked up as follows (in this case, AC inputs are L1-N):

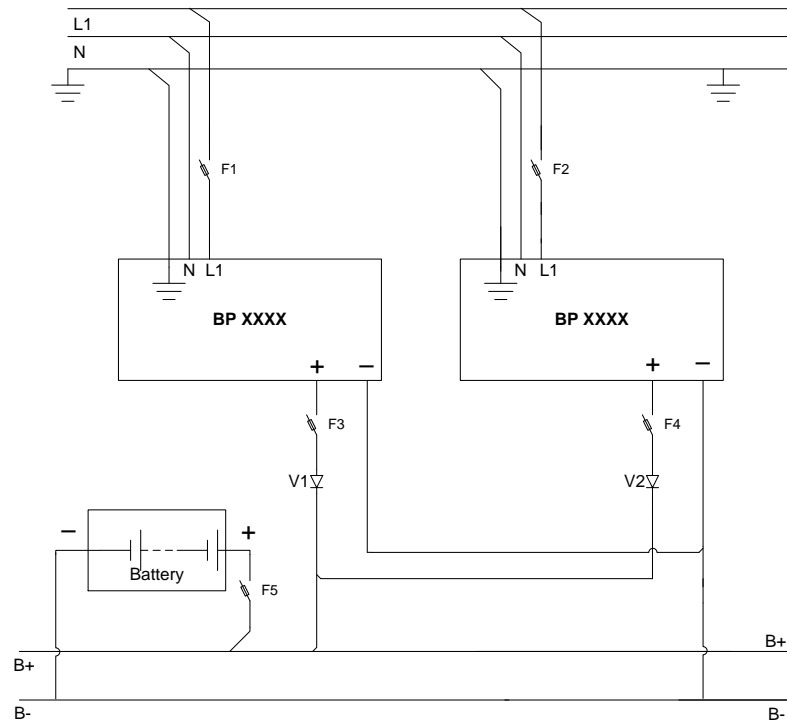


For an optimal charge:

1. Adjust to identical voltages on both chargers (at mid-run typically)
2. Connect the battery to be charged
3. Measure the current delivered by each charger
4. Increase the voltage of the charger that delivers fewer current or decrease the one of the other while keeping the correct voltage between the battery lugs; however, there is no warranty of currents balance.

As a battery is connected downstream, the diode causes a voltage drop (typically 0.3V).

## 2 BPR (COMPACT) RANGE

Diagram block:

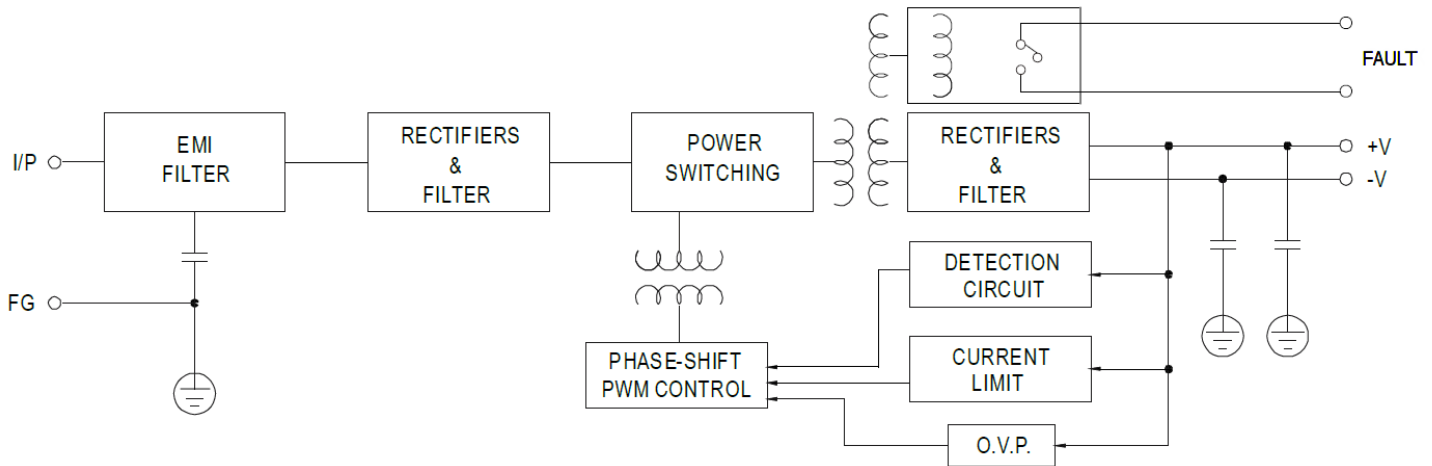

I/P = Input, FG = Front Ground, OVP = Over Voltage Protection

A DC OK isolated relay output is activated in event of any fault. It is an NO contact.

### 2.1 Protections

A Schottky diode must be installed on the output (positive terminal) to prevent reverse power in the case the battery has a higher voltage.

It might result from a power outage: then the relay opens, the led goes off (unless there is no diode). The battery higher voltage might also be due to the charge by a charge alternator of a generator.

Internal protections:

- Overcurrent: constant current limiting. The charger provides constant current even when the protection circuit is triggered; the current is clipped, until the peak disappears
- Short circuit: the output voltage drops; DC OK: led goes off, and the relay trips; automatic restart
- Overvoltage (e.g. if the connection to the battery is cut): in this event, no current is delivered; DC OK: led remains on, and relay does not trip (if the diode is installed). The charger restarts automatically
- Undervoltage: the relay trips until the dip disappears (above 10Vdc for BPR 0324S)

Reversal of polarity: if the output connections are reversed (charger – + battery), a higher current runs between charger + and battery – . Therefore:

<b>⚠ WARNING</b>		
<b>THE CHARGER HAS NO FUSE ON THE OUTPUT</b>		
Install a fuse on the positive output		
<b>Failure to follow this instruction may damage the charger</b>		

BPR	0324S	0512S
Recommended fuse rating	5A	7.5A

The led is still on and the relay circuit remains closed.

Example of installation (the fuse and fuse module on the right are NOT provided):



In this example, the diode is connected to the module on the right, but it can also span across the two smaller modules.

**AC side:** install a fuse or a breaker on the input. The AC currents, and inrush currents in cold start, show in the data sheets. We suggest the following:

	BPR	0324S / 0512S
Anti-surge fuse		T2.5A/L250V
Circuit-breaker C16. Max. count of chargers is		4

## 2.2 Connections

Recommended wires: made of copper, they must withstand temperatures of at least 80°C (e.g., UL1007).

Cross-section and tightening torque for terminals:

	BPR	0324S / 0512S
Cross-section		0.75 mm <sup>2</sup> (AWG18)
Tightening torque		50 N.m (4.4 lb-in)


Make sure that all strands of each stranded wire enter the connection terminal and the screw terminals are securely fixed to prevent poor contact.

### 2.3 Comparison of the various models

		Unit	BPR 0324S	BPR 0512S
<b>Output</b>	Current – rated/max	A	2.5	5
	Voltage - rated	VDC	24	12
	Voltage – adjust range	VDC	24 ... 30	12 ... 15
	Rated power	W	60	60
	Hold-up time	ms	50 @230VAC, 20 @115VAC	
<b>Input</b>	Voltage range	V	85 ... 264VAC, 120 ... 370VDC	
	Frequency range	Hz	47 ... 63	
	Current	A	1.8A @115VAC, 1A @230VAC	
	Inrush current (typ.)	A	Cold start 30A @115VAC, 60A @230VAC	
	Leakage current	mA	<1mA @240VAC	
<b>Efficiency</b>	typical,@ rated current	–	88%	86%
<b>Protection</b>	Overcurrent	%	105 ... 150%	
	Short-circuit	–	Yes	Yes
	Overvoltage	V	31.2 ... 36	15.6 ... 18
	Over temperature	°C	110±5	105±5
	Polarity reversal	–	With fuse	With fuse
<b>Functions</b>	Breaking power DC OK	V	30V, 1A resistive load	
Temperature	Working derate @higher	°C	–20 ... 55 ... 70	–25 ... 55 ... 70
	Working humidity	%RH	20 ... 90, non condensing	
	Storage	°C	–40 ... 85, 10 ... 95 %RH	
	Coefficient	%/°C	±0.03 @0 ... 50°C	
WxHxD		mm	40 x 90 x 100	
Weight		kg	0.33	
MTBF	MIL-HDBK217F @25°C	khour	299.2	
Vibrations	10 min/cycle, 60 min		Component: 2G @10...500Hz 3axes. Mounting clip compliant with IEC60068-2.6	
Isolation	@500 VDC 25°C 70%RH	MΩ	>100 between input, output and front ground	
Max voltage		VAC	3kV betw. input & output 1.5kV betw. input & ground, 0.5 kV betw. output & ground	

### 3 BP RANGE

Diagram block:

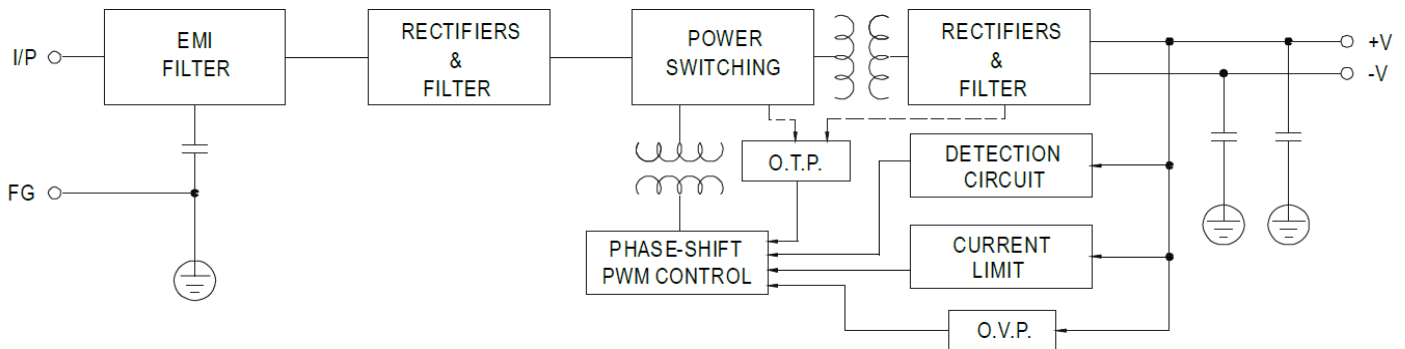

I/P = Input, FG = Front Ground

OVP = Over Voltage Protection

OTP = Over Temperature Protection by temperature switch (detection on one or both sides of the transformer)

Leakage current: the Y capacitors between I/P and FG cause some leakage current flow from line or neutral to the case; the leakage current to the case is not dangerous. A proper connection to ground discharges the case.

#### 3.1 Protections

A Schottky diode must be installed on the output (positive terminal) to prevent reverse power in the case the battery has a higher voltage (due to input outage [the led goes off unless there is no diode], or due to the charge alternator of a generator).

Internal protections (the front led DC OK goes off; additionally BP 4024T lights a red led ALARM):

- Overcurrent: constant current limiting. The charger provides constant current even when the protection circuit is triggered; the current is clipped, until the peak disappears
- Short circuit: the output voltage drops; automatic restart
- Overvoltage (e.g. if the connection to the battery is cut): in this event, no current is delivered; the led is still on. The charger restarts automatically (if the diode is installed)
- Over temperature: the voltage is not delivered anymore until the fault disappears.

OTP (Refer to block diagram)	BP 1024M	BP ●●●●M	BP 2024T	BP 4024T
Air detection	x			
Upstream detection on heat sink of power transistor (TSW)		x	x	x
Downstream detection on heat sink of power diode (TSW2)				x

Reversal of polarity: if the output connections are reversed (charger – + battery), a higher current runs between charger + and battery – . Therefore:

<b>⚠ WARNING</b>
<b>THE CHARGER REQUIRES A FUSE ON THE OUTPUT</b>
Install a fuse on the positive output
<b>Failure to follow this instruction may damage the charger</b>

	BP 1024M	BP 0524M	BP 1012M	BP 2024M	BP 2024T	BP 4024T
Recommended fuse rating	15A	7.5A	15A	25A/30A	25A/30A	50A

The DC OK led is still on.


**AC side:** insert a breaker or fuse. The AC currents, and inrush currents in cold start, show in the data sheets. We suggest the following:

BP	0524M	1012M	1024M	2024M	2024T	4024T
Anti-surge fuse	T4A/H250V	F4A/H250V	F5A/L250V	T15A/H250V	F6.3A/L250V	F6.3A/L250V
Circuit-breaker C16 Max. count of chargers is	14	5	4	3	3	2

Dual phase input in Wye connection: use of only two phases

BP	0524M	1012M	1024M	2024M	2024T	4024T
Connections	L-N				L1-L2, L2-L3, or L3-L1	<b>L1-L3</b>
Note	Phase to phase is forbidden				Output current derated by 20%	

Example for BP 2024T:

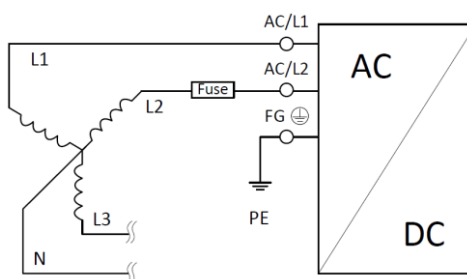

### 3.2 Connections

Recommended wires: made of copper, they must withstand temperatures of at least 80°C (e.g., UL1007), and have cross-sections as follows:

BP	0524M	1012M	1024M	2024M/T	4024T
Rated current (A)	5	10	10	20	40
Cross-section (mm <sup>2</sup> )	0.75	1	1	2.5	4
Cross-section (AWG)	18	16	16	12	11

Make sure that all strands of each stranded wire enter the terminal connection and the screw terminals are securely fixed to prevent poor contact.

Recommended screwdriver: 4mm, slotted type

Tightening torques of terminal screws:

BP	0524M and 1012M	1024M and 2024M/T	4024T
AC inputs	62 N.m (5.5 lb-in)	50 N.m (4.4 lb-in)	100 N.m (9 lb-in)
DC outputs	78 N.m (7 lb-in)		

### 3.3 Power factor

The power switching generates harmonics and the capacitors do not absorb currents in phase with the source.

Use BP1024M or BP2024M when the power factor is a concern:

- BP 1024M features an active PFC function; the block diagram is similar to the one of the BPRB range (without UVP, see further). This results in a high power factor.
- BP 2024M features a passive PFC function (low-frequency filter between rectifiers and power switching). This results in fewer harmonics and compliance with EN 61000-3-2 standard. The efficiency is higher.

### 3.4 Comparison of the various models

		Unit	BP 0524M	BP 1012M	BP 1024M	BP 2024M	BP2024T	BP 4024T	
<b>Output</b>	Current – rated/max	A	5	10	10	20	20	40	
	Voltage - rated	VDC	24	12	24		24		
	Voltage – adjust range	VDC	24 ... 28	12 ... 14	24 ... 28		24 ... 28		
	Rated power	W	120	120	240	480	480	960	
	Hold-up time	ms	36 @230VAC, 32 @115VAC		24 @230VAC 24 @115VAC	16@230VAC	16 @400VAC 35 @500VAC	14 @400VAC 30 @500VAC	
	Voltage total tolerance	%	±1.0	±2.0	±1.0		±1.0		
<b>Input</b>	Voltage range	VAC	88 ...132V, 176...264V switch.		85...110...264	180...264V	340 ... 550VAC		
	Frequency range	Hz	47 ... 63						
	Current	A	1.6 @230VAC, 2.6 @115VAC		1.4 @230VAC 2.8 @115VAC	4 @230VAC	1.7@400VAC 1.3 @500VAC	2 @400VAC 1.6 @500VAC	
	Inrush current (typ.) Cold start	A	40 @230VAC, 20 @115VAC		45 @230VAC 27 @115VAC	40@230VAC	50	50	
	Leakage current	mA	<3.5mA @240VAC					<3.5mA @530VAC	
	Power factor (typ.)	none			>0.96 @230V >0.99@115V	≥ 0.7			
<b>Efficiency</b>	typical,@ rated current	–	84%	80%	84%	89%	89%	91%	
<b>Protection</b>	Overcurrent	%power	105 ... 150%	105 ... 150%	105 ... 150%		105 ... 150%	105 ... 125%	
	Short-circuit	–	Yes	Yes	Yes		Yes		
	Overvoltage	V	29 ... 33	15 ... 16.5	30 ... 36		30 ... 36		
	Over temperature	°C	90±5	85±5		100±5	110±5		
	Polarity reversal		With fuse	With fuse	With fuse		With fuse		
Temperature	Working derate @higher	°C	-10 ... 45 ... 60	-10 ... 45 ... 60	-10... 55*...70	-20...50...70	-20 ... 50 ...70	-20 ...45...60	
	Working humidity	%RH	20 ... 90, non condensing		20 ... 90, non condensing				
	Storage	°C	-20 ... 85°C, 10 ... 95%RH				-40 ... 85°C, 10 ... 95%RH		
	Coefficient	%/°C	±0.03 @0 ... 50°C						
WxHxD		mm	65.5 x 125.2 x 100		125.5 (227) x 125.2 x 100		227 (276) x 125.2 x 100		
Weight		kg	0.79		1.2	2.4	2.5	3.3	
MTBF	MIL-HDBK217F @25°C	khour	432.1		289.9	180.9	91.1	122.5	
Vibrations	10 min/cycle, 60 min		Component: 2G @10...500Hz 3axes. Mounting clip compliant with IEC60068-2.6						
Isolation	@500 VDC 25°C 70%RH	MΩ	>100 between input, output and front ground						
Max voltage		VAC	3kV betw. input & output 1.5kV** betw. input & ground, 0.5 kV betw. output & ground						


\* Derating from 55°C @230 VAC, from 40°C @110VAC

\*\* 2 kV for BP 4024T



**4 BP+ RANGE**

Diagram block:

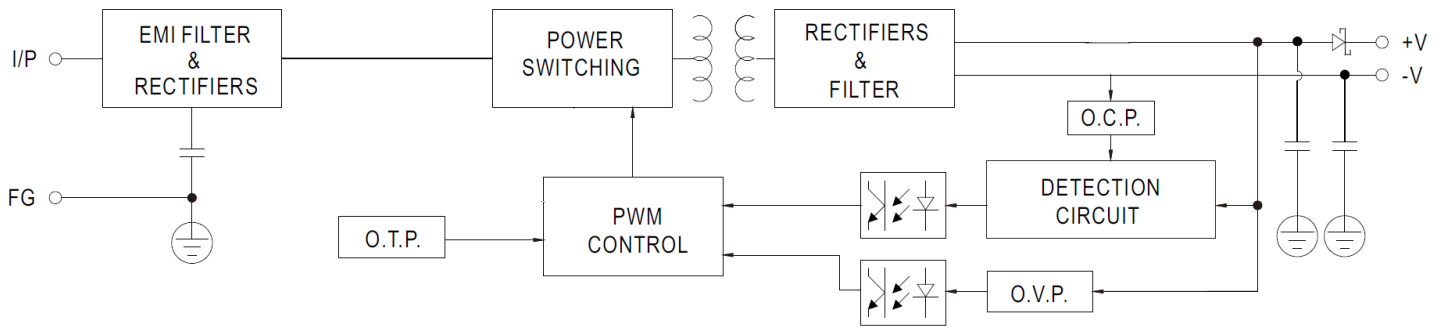

I/P = Input, FG = Front Ground

OCP = Over Current Protection

OVP = Over Voltage Protection

OTP = Over Temperature Protection by temperature switch (sensor in air)

Leakage current: the Y capacitors between I/P and FG cause some leakage current flow from line or neutral to the case; the leakage current to the case is not dangerous. A proper connection to ground discharges the case.

**4.1 Protections**

The **integral** Schottky diode prevents reverse power in the case the battery has a higher voltage (due to input outage [the led goes off], or due to the charge alternator of a generator).

Internal protections (the front led DC OK goes off):

- Overcurrent: constant current limiting. The charger provides constant current even when the protection circuit is triggered; the current is clipped, until the peak disappears
- Short circuit: the output voltage drops immediately; automatic restart
- Overvoltage (e.g. if the connection to the battery is cut): the diode limits the voltage
- Over temperature (detection in air): the voltage is not delivered anymore. Cycle the power.

Undervoltage on output: from 2VDC, the led turns off. Cycle the power.

Reversal of polarity: if the output connections are reversed (– charger to + battery), a higher current runs between charger + and battery –. Therefore:

⚠ WARNING
THE CHARGER REQUIRES A FUSE ON THE OUTPUT
Install a fuse on the positive output
Failure to follow this instruction may damage the charger

	BP+ 0512M	BP+0324M	BP+1012M	BP+0524M
Recommended fuse rating	7.5A	5A	15A	7.5A

The DC OK led is still on.

**AC side:** insert a breaker or fuse. The AC currents, and inrush currents in cold start, show in the technical documentations. We suggest the following:

BP+	0512M	0324M	1012M	0524M
Anti-surge fuse	T3.15A/L250V		T4A/L250V	
Circuit-breaker C16 Max. count of chargers is	6		5	

## 4.2 Connections

Recommended wires: made of copper, they must withstand temperatures of at least 80°C (e.g., UL1007), and have cross-sections as follows:

BP+	0512M	0324M	1012M	0524M
Rated current (A)	5	3	10	5
Cross-section (mm <sup>2</sup> )	0.75	0.75	1.3	0.75
Cross-section (AWG)	18	18	16	18

Make sure that all strands of each stranded wire enter the terminal connection and the screw terminals are securely fixed to prevent poor contact.

Recommended screwdriver: 3mm, slotted type

Tightening torques of terminal screws:

BP+	0512M and 0324M	1012M and 0524M
AC inputs	68 N.m (6 lb-in)	100 N.m (9 lb-in)
DC outputs	68 N.m (6 lb-in)	100 N.m (9 lb-in)


## 4.3 Comparison of the various models

Refer to the *Product information*.

**5 BPR B RANGE**

**5.1 Overview**

This range provides boost capability for quick charging of depleted batteries and maintenance (equalization of Pb-acid cells). This range features a small case width.

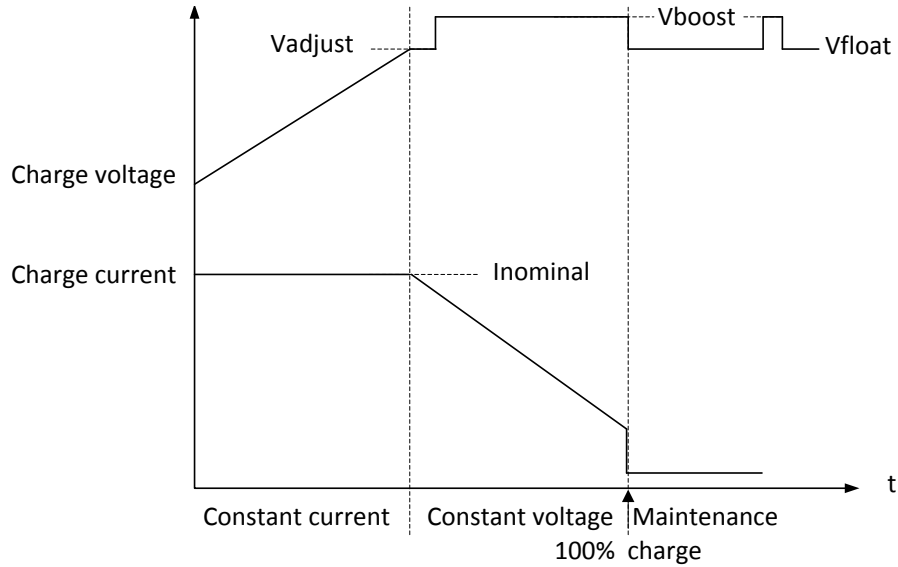

For two types of battery and two nominal voltages, the following table shows the recommended Float and Boost voltages (Vboost is 4 ... 5% above Vfloat):


Battery rated voltage	NiCd		Gel /Lead-acid	
	Vfloat	Vboost	Vfloat	Vboost
12V	13.2V	13.8V	13.7V	14.2V
24V	26.4V	27.6V	27.4V	28.4V

This table is given for information only; check with the battery manufacturer. From Vboost, calculate  $V_{adjust} = V_{boost} / 1.04$  (it should be close to Vfloat) and adjust the charger accordingly.

Diagram blocks:

BPR B 0524M and 1012M: the diagram block is similar to the one of BPR (with downstream OTP).

BPR B 1024M and 2024M include in addition a dual-stage active PFC to offer a high power factor:

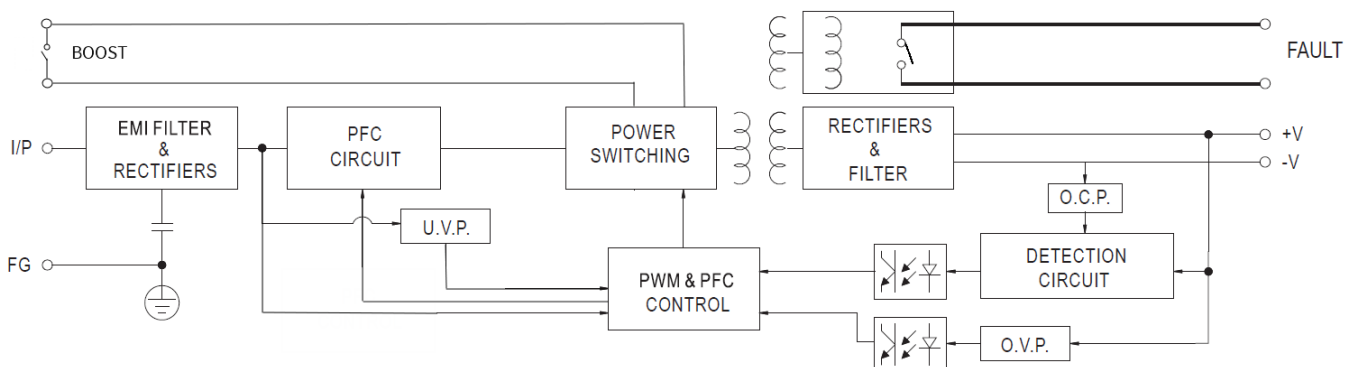

PFC = Power Factor Control

OCP = Over Current Protection

OVP = Over Voltage Protection, UVP = Under Voltage Protection

OTP = Over Temperature Protection (not depicted) by upstream temperature switch (TSW): detection on heat sink of power transistor

**5.2 Protections**

A Schottky diode must be installed on the output (positive terminal) to prevent reverse power in the case the battery has a higher voltage (due to input outage, or due to the charge alternator of a generator).

Internal protections:

- Overcurrent: constant current limiting. The charger provides constant current even when the protection circuit is triggered; the current is clipped, until the peak disappears
- Short circuit: the output voltage drops; FAULT relay trips; automatic restart
- Overvoltage (e.g. if the connection to the battery is cut): in this event, no current is delivered; FAULT relay does not trip. To restart the charger, disconnect and reconnect the input
- Undervoltage: if the rectified input voltage is below a threshold, a protection is triggered (UVP of 1024M & 2024M): FAULT relay trips. If output voltage drops, the relay trips also
- Over temperature: the relay trips; the voltage is not delivered anymore until the fault disappears

Reversal of polarity: if the output connections are reversed (charger – |> + battery), a higher current runs between charger + and battery –. Therefore:


<b>⚠ WARNING</b>
<b>THE CHARGER REQUIRES A FUSE ON THE OUTPUT</b>
Install a fuse on the positive output
<b>Failure to follow this instructions may damage the charger</b>

BPR B	0524M	1012M	1024M	2024M
Recommended fuse rating	7.5A	15A	15A	25A/30A

The DC OK isolated relay output is activated in event of any fault.

**AC side:** insert a breaker or fuse (if in Wye connection, on L2 as illustrated). The AC currents, and inrush currents in cold start, show in the data sheets. We suggest the following ratings:

BPR B	0524M ,1012M, 1024M	2024M
Fuse	T4A/H250V	T6.3A/H250V
Circuit-breaker - C16 curve	10 ... 20A	

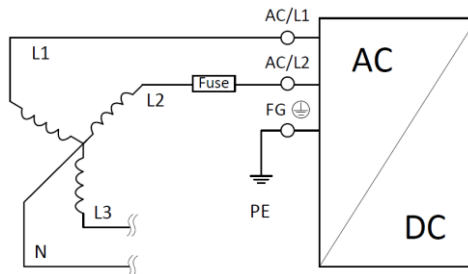

### 5.3 BPR B connections

#### POWER and GROUND

Recommended wires: made of copper, they must withstand temperatures of at least 80°C (e.g., UL1007), and have cross-sections as follows:

BPR B	0524M	1012M and 1024M	2024M
Rated current +30% (A)	6.5	13	22
Cross-section (mm <sup>2</sup> )	1	1.5	4
Cross-section (AWG)	16	14	10

Make sure that all strands of each stranded wire enter the terminal connection and the screw terminals are securely fixed to prevent poor contact. BPR B 1024M and BPR B 2024M feature two outputs; use both to prevent too much current stress on a single one.

STATUS and COMMAND: 0.5mm<sup>2</sup> (AWG22)

Recommended screwdrivers: 3mm, slotted type, with tightening torques that follow for terminal screws:

BPR B	0524M and 1012M	1024M and 2024M
AC inputs	50 N.m (4.4 lb-in)	100 N.m (9 lb-in)
DC outputs	78 N.m (7 lb-in)	

### 5.4 Operation

The boost can be activated:

- Manually through a button on another module
- Or automatically by an external PLC

The module/PLC is connected to the charger through a 2-pin block; a cord with two 30 cm (1') wires and a male terminal block is provided together with the charger.

Procedure:

1. Connect the charger signals (status and boost command) to the module/PLC
2. Connect the AC input
3. Adjust the output voltage
4. Connect the battery
5. If the boost is manually operated, press the button whenever required.

## 5.5 Comparison of the various models

		Unit	BPRB 0524M	BPRB 1012M	BPRB 1024M	BPRB 2024M
<b>Output</b>	Current – rated/max	A	5	10	10	20
	Voltage - rated	VDC	24	12	24	24
	Voltage – adjust range	VDC	24 ... 29	12 ... 15	24 ... 28	24 ... 28
	Voltage - boost	VDC	When contact is closed, Vadjusted $\pm$ 4 ... 5%			
	Rated power	W	120	120	240	480
	Hold-up time	ms	50 @400VAC, 10 @230VAC		18 @400VAC, 18@230VAC	18 @400VAC, 16 @230VAC
	Voltage total tolerance	%	$\pm$ 1.0	$\pm$ 1.5	$\pm$ 1.0	$\pm$ 1.5
<b>Input</b>	Voltage range	VAC	180 ... 550VAC, the max. charge is derated under 200VAC			
	Frequency range	Hz	47 ... 63			
	Current	A	0.6A @400VAC, 1.25 @230VAC		1A @400VAC, 2 @230VAC	1.6A @400VAC, 4 @230VAC
	Inrush current (typ.)	A	Cold start: 50A			
	Leakage current	mA	<3.5mA @530VAC			
	Power factor (typ.)	none			>0.84 @400VAC >0.84 @230VAC	>0.84 @400VAC >0.84 @230VAC
<b>Efficiency</b>	typical,@ rated current	–	90%@400VAC	88%@400VAC	90.5%	91%
<b>Protection</b>	Overcurrent	%power	105 ... 130%	105 ... 130%	105 ... 150%	105 ... 130%
	Short-circuit	–	Yes	Yes	Yes	Yes
	Overvoltage	V	31 ... 37	16 ... 18	31 ... 38	31 ... 38
	Over temperature	°C	110 $\pm$ 5	105 $\pm$ 5	90 $\pm$ 5	95 $\pm$ 5
	Polarity reversal		With fuse	With fuse	With fuse	With fuse
<b>Functions</b>	Breaking power FAULT	V	30V / 1A resistive load			
	Boost input		2-pin keyed front socket, module and cord (30 cm/1') are provided			
Temperature	Working derate @higher	°C	-25 ... 60 ... 70	-25 ... 50 ... 70	-30 ... 60 ... 70	-30 ... 50 ... 70
	Working humidity	%RH	20 ... 90, non condensing		20 ... 95, non condensing	
	Storage	°C	-40 ... 85°C, 10 ... 95%RH			
	Coefficient	%/°C	$\pm$ 0.03 @0 ... 50°C			
WxHxD		mm	40 x 125.2 x 113.5		63 x 125.2 x 113.5	85.5 x 125.2 x 128.5
Weight		kg	0.65		1.06	1.7
MTBF	MIL-HDBK217F @25°C	khour	268		141.1	112.8
Vibrations	10 min/cycle, 60 min		Component: 2G @10...500Hz 3axes. Mounting clip compliant with IEC60068-2.6			
Isolation	@500 VDC 25°C 70%RH	MΩ	>100 between input, output and front ground			
Max voltage		VAC	3k betw. input & output 2k betw. input & ground, 0.5 k betw. output & ground/ FAULT			

CRE TECHNOLOGY

130 allée Charles-Victor Naudin  
Zone des Templiers  
Sophia-Antipolis  
06410 BIOT  
FRANCE

Phone: +33 (0)4 92 38 86 82

Fax: +33 (0)4 92 38 86 83


Website: [www.cretechnology.com](http://www.cretechnology.com)

Email: [info@cretechnology.com](mailto:info@cretechnology.com)

Technical support: +33 (0)4 92 38 86 86 (office hours: 8.30AM - 12AM / 2PM - 6PM GMT +1) Email: [support@cretechnology.com](mailto:support@cretechnology.com)

SKYPE: [support-cretechnology.com](https://www.skype.com/join/support-cretechnology-com) (voice only)

A worldwide coverage:

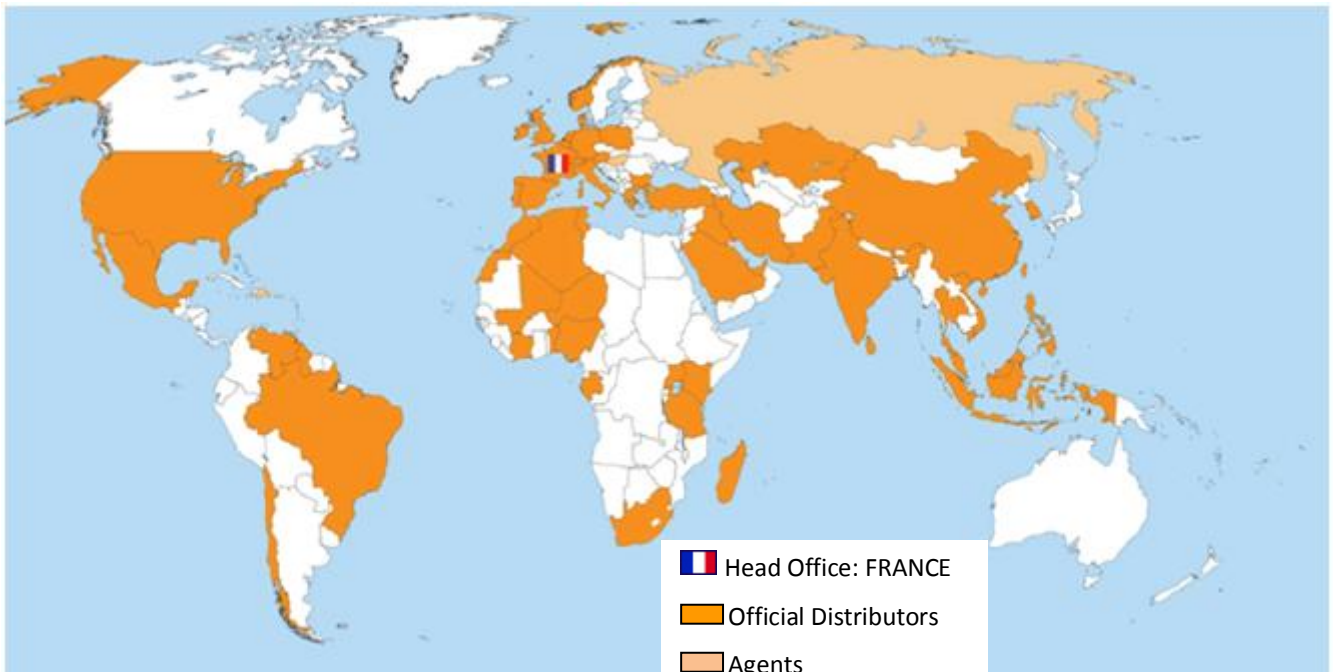

Check our entire distributors list around the world on [www.cretechnology.com](http://www.cretechnology.com), button «DISTRIBUTORS».

NEW WEB SITE

[www.cretechnology.com](http://www.cretechnology.com)

CRE TECHNOLOGY has provided the engine and generator industry for over 25 years with standard products and dedicated solutions for engine control, generator protection and paralleling.

All application fields where power is the core resource of performance are covered by CRE TECHNOLOGY. The company is a reference in the industrial, marine and defense businesses.

Our very strong situation allows us to invest, feeding our ambition to be always more advanced, always closer to you. The coming years will see the broadening of our distribution network and of our innovative products portfolio.

BECOME A CRE TECHNOLOGY DISTRIBUTOR

#### YOUR ACCOUNT & YOUR PRICES

By creating your account, you'll have access to all your personal data. All the prices of the new CRE TECHNOLOGY website correspond to your business rates.

GET INFORMATION THE WAY YOU WANT IT  
Fill your cart by choosing the products you want and get all the information you need.

#### EVERYWHERE WITH YOU

The new CRE TECHNOLOGY website is designed to be responsive to smartphones and touch tablets.

It allows you to consult the documents related to the CRE TECHNOLOGY's ranges of products.

